FULLER
ELECTROMECHANICAL CO.

PUMPSENSE

PUMPSENSE
Fluid Engineering Pvt. Ltd





NFPA®

NFPA 20 **FIRE** PUMPS

COMPLETE PUMPING SOLUTIONS FOR FIRE PROTECTION SYSTEMS

- Horizontal Split Case Single Stage and Two Stage Electric Motor Driven Fire Pumps
- Horizontal Split Case Single Stage and Two Stage Diesel Engine Driven Fire Pumps
- Vertical Split Case Electric Motor Driven Fire Pumps
- End Suction Fire Pumps
- Single Stage Inline Fire Pumps
- Fifi-Pumps for external fire fighting in ships and FPSO Fire Pumps units
- Packaged Fire Pumps Systems
- Approved and Listed Fire Pumps

FULLER
ELECTROMECHANICAL CO.

PUMPSENSE

UL Listed & FM Approved Pumps



Complete Pumping Solutions For Fire Protection Systems

- Horizontal Split Case Single Stage & Two Stage Electric Motor Driven Fire Pumps
- Horizontal Split Case Single Stage & Two Stage Diesel Engine Driven Fire Pumps
- End Suction Fire Pumps
- Packaged Fire Pumps Systems
- Ul 448 & Fm 1311 Approved For Fire Protection Service

FULLER
ELECTROMECHANICAL CO.

PUMPSENSE




A Brief Introduction

History of PUMPSENSE goes back to 1995 when a group of professionals working in large international pumps companies decided to team together. At PUMPSENSE, we are united through which we can express ourselves fully and freely. Each one of us has an abiding interest in one aspect or the other of the pumps business – right from hydraulic design to applications engineering, product development to marketing. We also share a common conviction that with our skills, passion, and commitment, we can redefine the existing norms and standards of customer satisfaction. We wish to work, learn and create value in a nourishing and fulfilling environment for our customers, business associates and ourselves. PUMPSNESE exists to fulfill this collective dream, based on a core set of values which are our guiding philosophy in creating this organization.

FULLER
ELECTROMECHANICAL CO.

PUMPSENSE

The Business of PUMPSENSE is to provide centrifugal pumps and related services. We will constantly strive to increase the delivered value to our customer by careful attention to details, by continuous improvement of our core capabilities and by our commitment to delight the customer at every point of contact. The quality of our products and services will reflect the improvement in quality of life that we are able to bring to our employees. We will provide them with an informal and liberal work environment, where they can constantly learn and grow. We recognize that our suppliers play a key role in the quality of our products and services. We will work closely with our suppliers so that they share our energy and focus to serve the customer with excellence. Above all, we will strive to create an organization where there are no barriers amongst customers, employees and suppliers and all of us work together to create value, to grow, to learn and to enhance the quality of our lives.

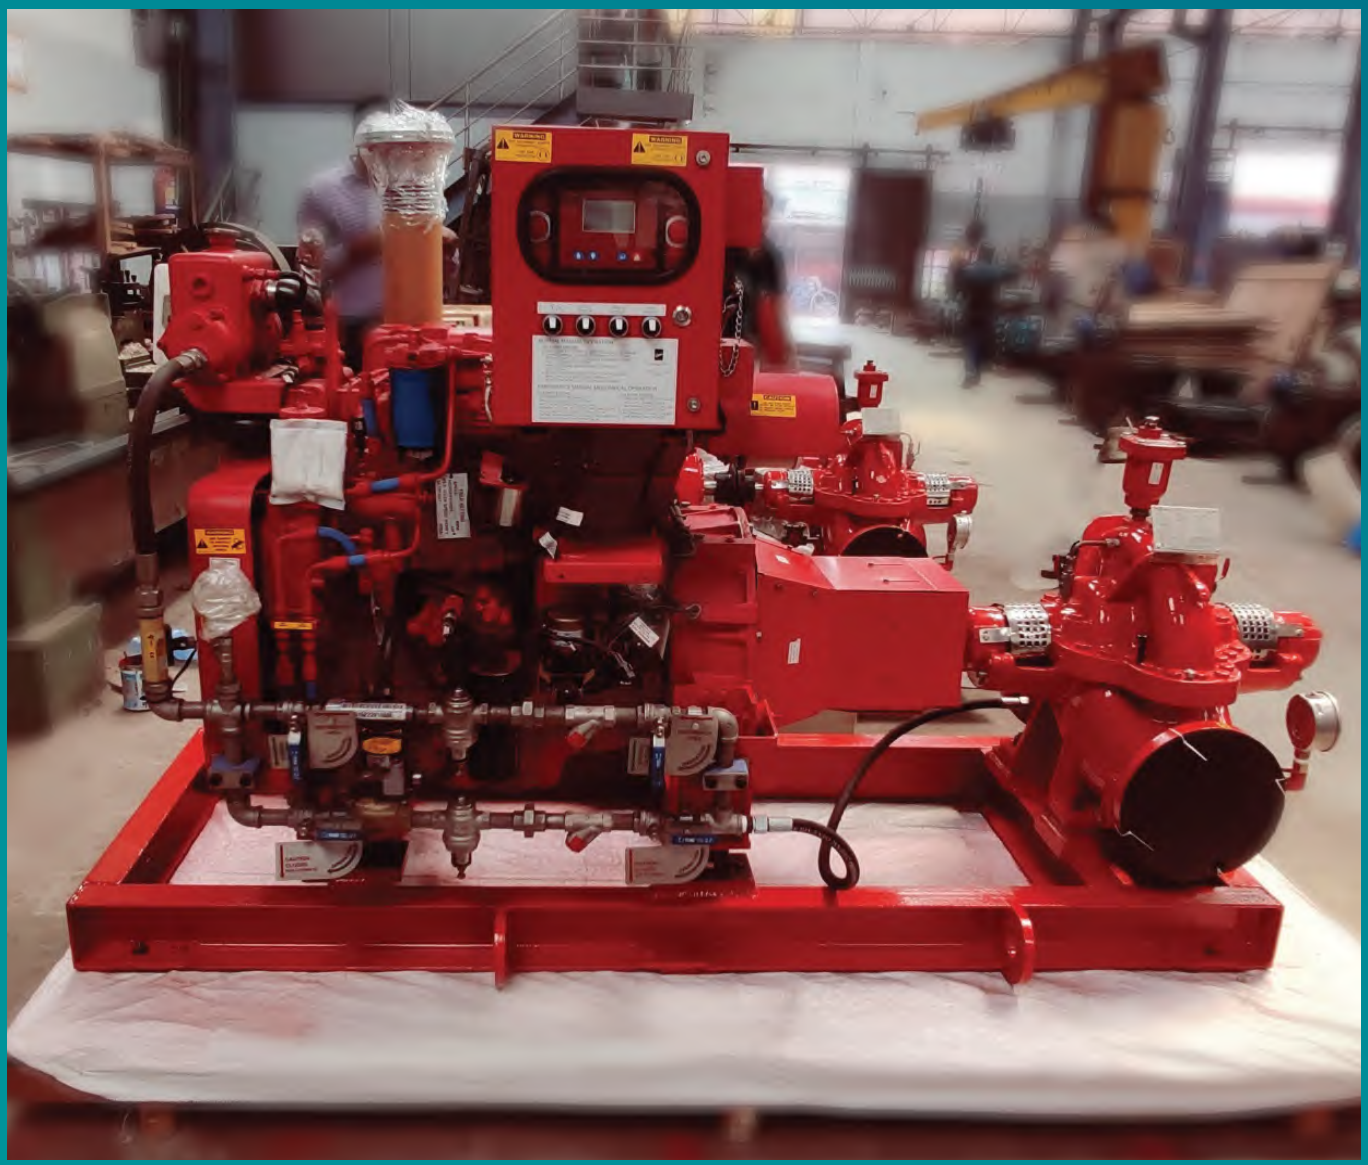

FULLER
ELECTROMECHANICAL CO.

Certificates of Compliance

PUMPSENSE



FM APPROVED

Certificate of Compliance

This certificate is issued for the following:

Centrifugal Fire Pumps
(Axial Split-Case Type)

Models 6HF18, 6HF21, 8HF17 and 8HF21
(see ratings on page 2)

Prepared for:

Pumpsense Fluid Engineering Private Limited
96, Garden Reach Rd
5/F, Hastings Court, Tower A
Kolkata 700023
India

FM Approvals Class: 1311

Approval Identification: 3052348 Approval Granted: July 20, 2017

To verify the product continues to be Approved please refer to www.approvalguide.com.

Said Approval is subject to satisfactory field performance, continuing Surveillance Audits, and strict conformity to the constructions as shown in the Approval Guide, an online resource of FM Approvals.

David B. Fuller
VP - Manager of Fire Protection
FM Approvals
1151 Boston-Providence Turnpike
Norwood, MA 02062 USA

FM Approvals
Member of the FM Global Group



FM APPROVED

Certificate of Compliance

This certificate is issued for the following:

Centrifugal Fire Pumps
(Axial Split-Case Type)

Models 4HF12, 4HF12L, 5HF11, 6HF12, 8HF13
(see ratings attached)

Prepared for:

Pumpsense Fluid Engineering Pvt Ltd.
96 Garden Reach Rd
5/F Hastings Court, Tower A
Kolkata 700023
India

FM Approvals Class: 1311 (January 2018)

Approval Identification: PR449206 Approval Granted: November 19, 2019

To verify the product continues to be Approved please refer to www.approvalguide.com.

Said Approval is subject to satisfactory field performance, continuing Surveillance Audits, and strict conformity to the constructions as shown in the Approval Guide, an online resource of FM Approvals.

David B. Fuller
VP, Manager – Fire Protection
FM Approvals
1151 Boston-Providence Turnpike
Norwood, MA 02062

FM Approvals
Member of the FM Global Group

Page 1 of 3



FM APPROVED

Certificate of Compliance

This certificate is issued for the following:

Centrifugal Fire Pumps
(Axial Split-Case Type)

Models 4HF10, 6HF10, 6HF14K, 8HF15, 8HF20
(see attached listing)

Prepared for:

Pumpsense Fluid Engineering Pvt Ltd
96 Garden Reach Rd
5/F Hastings Court, Tower A
Kolkata 700023
India

FM Approvals Class: 1311 (December 2020)

Approval Identification: PR460212 Approval Granted: December 21, 2021

To verify the product continues to be Approved please refer to www.approvalguide.com.

Said Approval is subject to satisfactory field performance, continuing Surveillance Audits, and strict conformity to the constructions as shown in the Approval Guide, an online resource of FM Approvals.

David B. Fuller
VP, Manager – Fire Protection
FM Approvals
1151 Boston-Providence Turnpike
Norwood, MA 02062

FM Approvals
Member of the FM Global Group

Page 1 of 3

FULLER
ELECTROMECHANICAL CO.

Certificates of Compliance

PUMPSENSE

CERTIFICATE OF COMPLIANCE

Certificate Number EX28544
Report Reference EX28544-20210514
Date 2021-May-25

Issued to: PUMPSENSE FLUID ENGINEERING PVT LTD
5F, TOWER-A, HASTINGS COURT
96, GARDEN REACH ROAD
KOLKATA West Bengal, 700023 IN

This is to certify that representative samples of CENTRIFUGAL FIRE PUMPS, END SUCTION
See Addendum Page for Product Designation(s).

Have been investigated by UL in accordance with the Standard(s) indicated on this Certificate.

Standard(s) for Safety: UL 448 - Standard for Pumps for Fire-Protection Service

Additional Information: See the UL Online Certifications Directory at https://iq.ulprospector.com for additional information

This Certificate of Compliance does not provide authorization to apply the UL Mark. Only the UL Follow-Up Services Procedure provides authorization to apply the UL Mark.

Only those products bearing the UL Mark should be considered as being UL Certified and covered under UL's Follow-Up Services.

Look for the UL Certification Mark on the product.

Bruce Mahrenholz, Director North American Certification Program
UL LLC

Any information and documentation involving UL Mark services are provided on behalf of UL LLC (UL) or any authorized licensee of UL. For questions, please contact a local UL Customer Service Representative at http://ul.com/aboutul/locations/

CERTIFICATE OF COMPLIANCE

Certificate Number EX28544
Report Reference EX28544-20210514
Date 2021-May-25

This is to certify that representative samples of the product as specified on this certificate were tested according to the current UL requirements

Centrifugal Fire Pumps, End Suction
Models: EF 80-310, EF100-310

Bruce Mahrenholz, Director North American Certification Program
UL LLC

Any information and documentation involving UL Mark services are provided on behalf of UL LLC (UL) or any authorized licensee of UL. For questions, please contact a local UL Customer Service Representative at http://ul.com/aboutul/locations/

CERTIFICATE OF COMPLIANCE

Certificate Number EX27294
Report Reference EX27294-20161205
Date 2021-March-23

Issued to: PUMPSENSE FLUID ENGINEERING PVT LTD
5F, TOWER-A, HASTINGS COURT
96, GARDEN REACH ROAD
KOLKATA West Bengal, 700023 IN

This is to certify that representative samples of CENTRIFUGAL FIRE PUMPS, SPLIT CASE
See Addendum Page for Product Designation(s).

Have been investigated by UL in accordance with the Standard(s) indicated on this Certificate.

Standard(s) for Safety: UL 448 - Standard for Pumps for Fire-Protection Service

Additional Information: See the UL Online Certifications Directory at https://iq.ulprospector.com for additional information

This Certificate of Compliance does not provide authorization to apply the UL Mark. Only the UL Follow-Up Services Procedure provides authorization to apply the UL Mark.

Only those products bearing the UL Mark should be considered as being UL Certified and covered under UL's Follow-Up Services.

Look for the UL Certification Mark on the product.

Bruce Mahrenholz, Director North American Certification Program
UL LLC

Any information and documentation involving UL Mark services are provided on behalf of UL LLC (UL) or any authorized licensee of UL. For questions, please contact a local UL Customer Service Representative at http://ul.com/aboutul/locations/

CERTIFICATE OF COMPLIANCE

Certificate Number EX27294
Report Reference EX27294-20161205
Date 2021-March-23

This is to certify that representative samples of the product as specified on this certificate were tested according to the current UL requirements

Product Designation(s).:

USL - Centrifugal Fire Pumps, Split Case

All models are intended for installation with the shaft in the horizontal position.

Fire Pumps : Multistage
Model Designation: 3HFT11, 6HFTD12L

Fire Pumps: Single Stage
4HF12L, 4HF10, 4HF13, 4HF12, 5HF11, 6HF14K, 6HF10, 6HF20, 6HF12, 8HF13, 8HF20, 8HF22, 8HF15

Bruce Mahrenholz, Director North American Certification Program
UL LLC

Any information and documentation involving UL Mark services are provided on behalf of UL LLC (UL) or any authorized licensee of UL. For questions, please contact a local UL Customer Service Representative at http://ul.com/aboutul/locations/

FULLER ELECTROMECHANICAL CO.

PUMPSENSE UL Listed Centrifugal Fire Pumps (UL 448) Split-Case, Single Stage

PUMPSENSE

Rated Capacity (usgpm)	Rated Net Pressure Range (psi)	Approx. Speed (rpm)	Size (in.)	Model Designation
300	53-100	2800	6x4	4HF10
	59-112	2950		
	62-116	3000		
	76-141	3300		
	89-163	3550		
	88-139	2600	6x4	4HF12L
	104-161	2800		
	116-180	2950		
	120-186	3000		
400	50-98	2800	6x4	4HF10
	56-109	2950		
	59-113	3000		
	72-138	3300		
	85-161	3550		
	84-134	2600	6x4	4HF12L
	99-157	2800		
	111-175	2950		
	115-182	3000		
450	49-95	2800	6x4	4HF10
	55-107	2950		
	57-111	3000		
	70-136	3300		
	83-159	3550		
	81-132	2600	6x4	4HF12L
	96-155	2800		
	108-173	2950		
	113-179	3000		
500	46-93	2800	6x4	4HF10
	53-105	2950		
	55-108	3000		
	69-134	3300		
	81-157	3550		
	78-129	2600	6x4	4HF12L
	93-152	2800		
	105-171	2950		
	109-177	3000		
	130-176	2600	6x4	4HF13
	153-206	2800		
	171-230	2950		
	177-238	3000		
750	79-124	2600	6x4	4HF12
	96-149	2800		
	106-169	2950		
	109-176	3000		
	114-162	2600	6x4	4HF13
	137-192	2800		
	155-215	2950		
	162-224	3000		

FULLER
ELECTROMECHANICAL CO.

PUMPSENSE

PUMPSENSE UL Listed Centrifugal Fire Pumps (UL 448) Split-Case, Single Stage

Rated Capacity (usgpm)	Rated Net Pressure Range (psi)	Approx. Speed (rpm)	Size (in.)	Model Designation
1000	82-124	2600	6x5	5HF11
	97-147	2800		
	109-165	2950		
	113-171	3000		
	78-105	2800	6x6	6HF10
	87-117	2950		
	90-121	3000		
	106-145	3300		
	124-169	3550		
	127-175	2600	8x6	6HF14K
	151-206	2800		
	169-230	2950		
	175-239	3000		
1250	74-101	2800	6x6	6HF10
	83-113	2950		
	86-117	3000		
	103-141	3300		
	120-165	3550		
	113-180	3000	8x6	6HF12
	80-122	1500	8x6	6HF20
	113-173	1760		
	119-182	1800		
1500	98-136	3300	6x6	6HF10
	116-160	3550		
	106-172	3000	8x6	6HF12
	76-117	1500	8x6	6HF20
	109-167	1760		
	115-175	1800		
2000	120-148	2800	10x8	8HF13
	136-167	2950		
	141-173	3000		
	82-122	2100	12x8	8HF15
	106-155	2350		
	80-122	1500	10x8	8HF20
	115-172	1760		
	121-181	1800		
	119-150	1480	10X8	8HF22
	123-154	1500		
2500	141-164	2800	12x8	8HF15
	160-185	2950		
	74-115	1500	10x8	8HF20
	110-166	1760		
	115-175	1800		
	114-144	1480	10X8	8HF22
	117-149	1500		
3000	132-155	2800	12x8	8HF15
	149-176	2950		

FM Approved Centrifugal Fire Pumps (FM 1311)

Horizontal Split-Case, Single stage

Rated Capacity (gal/min)	Rated Net Head at Rated Capacity (psi)	Rated Speed (r/min)	Suction Inlet, dia. (in.)	Discharge Outlet, dia. (in.)	Product
300	52-93	2800	6	4	4HF10
	58-103	2950			
	60-107	3000			
	71-140	3300			
	82-162	3550			
	88-139	2600	6	4	4HF12L
	104-162	2800			
	116-180	2950			
	120-187	3000			
400	49-89	2800	6	4	4HF10
	55-100	2950			
	58-104	3000			
	70-137	3300			
	82-159	3550			
	85-135	2600	6	4	4HF12L
	99-158	2800			
	111-177	2950			
	115-183	3000			
450	47-87	2800	6	4	4HF10
	53-98	2950			
	56-102	3000			
	69-136	3300			
	80-158	3550			
	82-133	2600	6	4	4HF12L
	97-155	2800			
	109-174	2950			
	113-181	3000			
500	45-85	2800	6	4	4HF10
	51-96	2950			
	53-99	3000			
	67-133	3300			
	79-157	3550			
	78-129	2600	6	4	4HF12L
	94-152	2800			
	106-171	2950			
	110-177	3000			
750	79-122	2600	6	4	4HF12
	94-147	2800			
	107-166	2950			
	112-172	3000			
1000	80-126	2600	6	5	5HF11
	95-148	2800			
	107-167	2950			
	111-173	3000			
	78-106	2800	6	6	6HF10
	88-118	2950			
	91-123	3000			
	105-148	3300			
	123-173	3550			

FULLER
ELECTROMECHANICAL CO.

FM Approved Centrifugal Fire Pumps (FM 1311)

Horizontal Split-Case, Single stage

PUMPSENSE

Rated Capacity (gal/min)	Rated Net Head at Rated Capacity (psi)	Rated Speed (r/min)	Suction Inlet, dia. (in.)	Discharge Outlet, dia. (in.)	Product
1000	135-173	2600	8	6	6HF14K
	159-204	2800			
	178-229	2950			
	185-237	3000			
1250	74-102	2800	6	6	6HF10
	83-115	2950			
	87-119	3000			
	101-145	3300			
	119-169	3550			
1250	83-132	2600	8	6	6HF12
	134-154	2800			
	115-170	2950			
	121-179	3000			
1500	108-165	2950	8	6	6HF12
	114-174	3000			
	101-124	1800	8	6	6HF18
	100-140	1480	8	6	6HF21
2000	120-146	2800	10	8	8HF13
	135-166	2950			
	138-173	3000			
	83-120	2100	12	8	8HF15
	106-153	2350			
	110-140	1770	10	8	8HF17
	80-116	1470	10	8	8HF20
	118-170	1760			
	123-178	1800			
	98-126	1480	10	8	8HF21
2500	100-146	2350	12	8	8HF15
	144-167	2800			
	162-187	2950			
2500	106-136	1770	10	8	8HF17
2500	73-110	1470	10	8	8HF20
	112-165	1760			
	118-173	1800			
3000	137-160	2800	12	8	8HF15
	154-179	2950			

VENDORS LIST

: Pumps (Pumpsense,U.A.E)

: Diesel Engine (Kirloskar,India)

: Electric Motor (Marathon, U.S.A)

: Controller (Tornatech,U.A.E)


: Casing Relief Valve (Cla-Val,Switzerland)

: Pressure Relief Valve (Singer,Canda)


FULLER
ELECTROMECHANICAL CO.

PUMPSENSE

Cross Sectional Drawing For End Suction Fire Pump

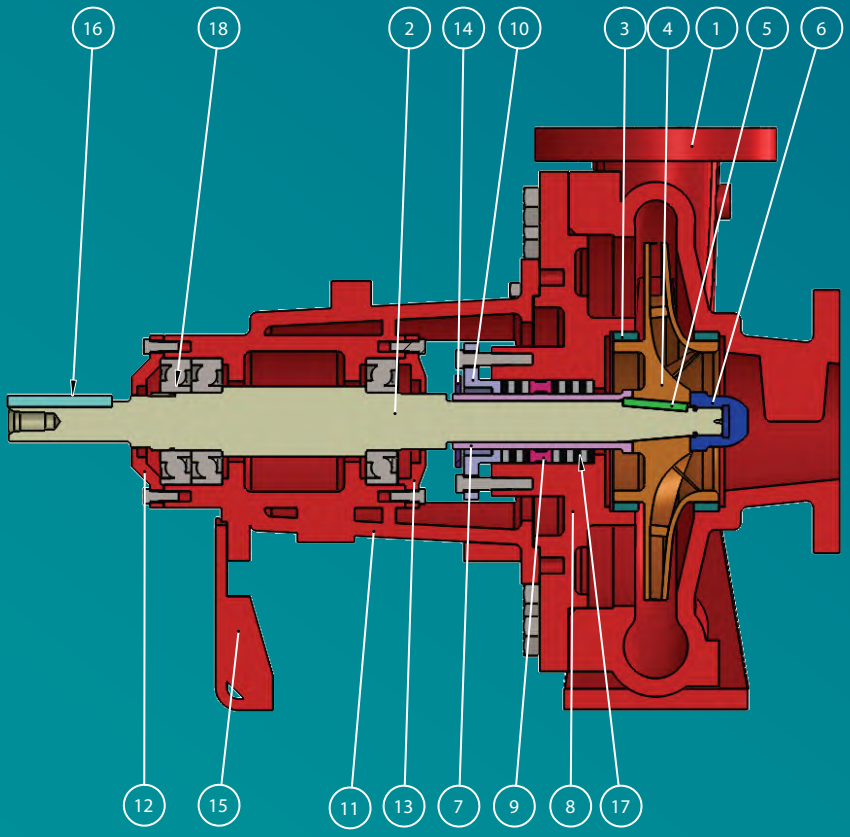


ITEM NO.	DESCRIPTION	QTY.
1	CASING	1
2	SHAFT	1
3	WEAR RING	2
4	IMPELLER	1
5	IMPELLER KEY	1
6	IMPELLER NOSE CAP	1
7	SHAFT SLEEVE	1
8	BACK COVER	1
9	LANTERN RING	1
10	SPLIT GLAND	1
11	BEARING BRACKET	1
12	BEARING END COVER PE	1
13	BEARING END COVER FE	1
14	WATER THROWER	1
15	SUPPORT FOOT	1
16	COUPLING KEY	1
17	GLAND PACKING	5
18	BEARINGS (DE + NDE)	3

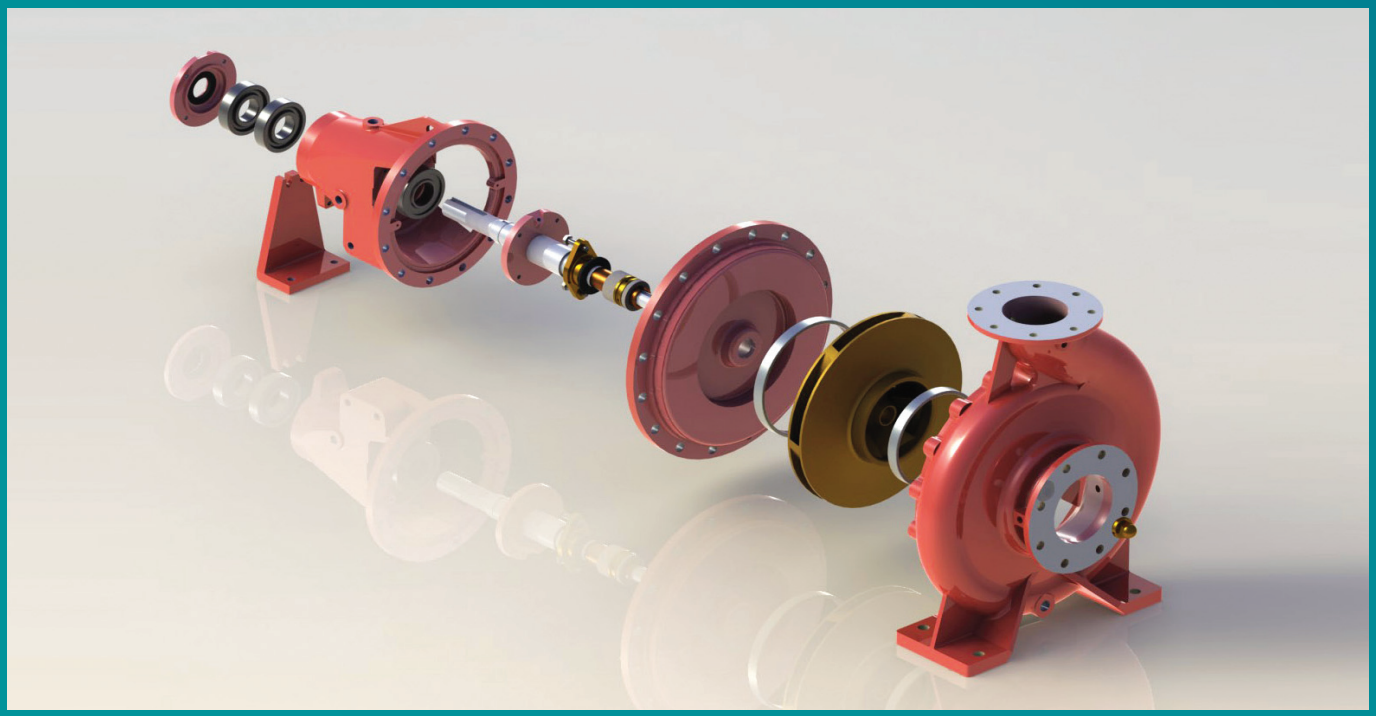

FULLER
ELECTROMECHANICAL CO.


PUMPSENSE

Cross Sectional Drawing For Single Stage Split-Case Pump

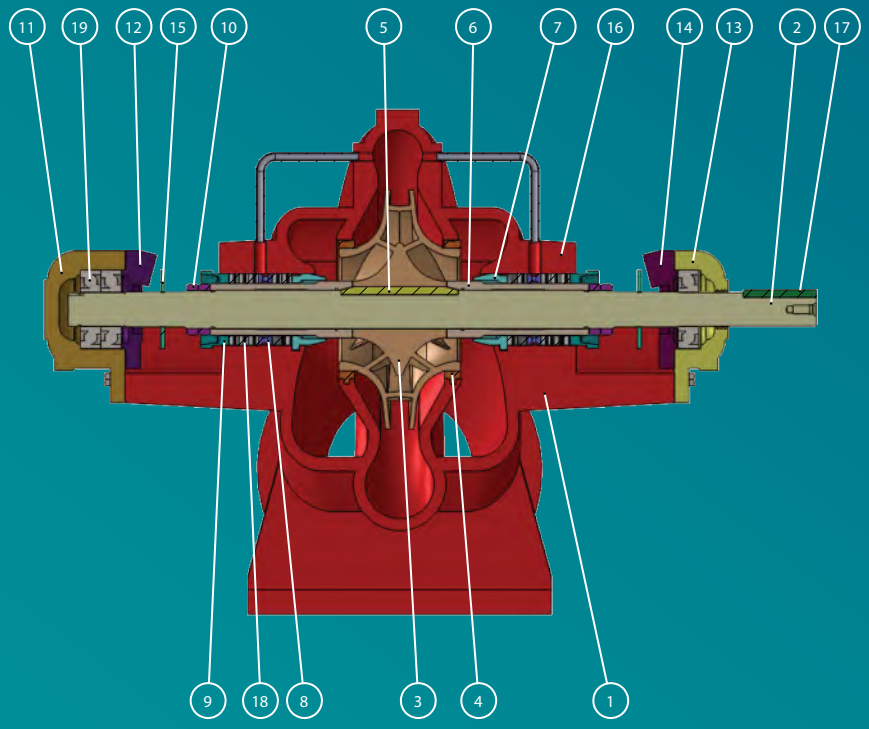

ITEM NO.	DESCRIPTION	QTY.
1	CASING BOTTOM HALF	1
2	SHAFT	1
3	IMPELLER	1
4	WEAR RING	2
5	IMPELLER KEY	1
6	SHAFT SLEEVE	2
7	STUFFING BOX BUSH	2
8	LANTERN RING	2
9	SPLIT GLAND	2
10	SLEEVE NUT	4
11	BEARING HOUSING (NDE)	1
12	BEARING END COVER (NDE)	1
13	BEARING HOUSING (DE)	1
14	BEARING END COVER (DE)	1
15	WATER THROWER	2
16	CASING TOP HALF	1
17	COUPLING KEY	1
18	GLAND PACKING	10
19	BEARINGS (DE + NDE)	3



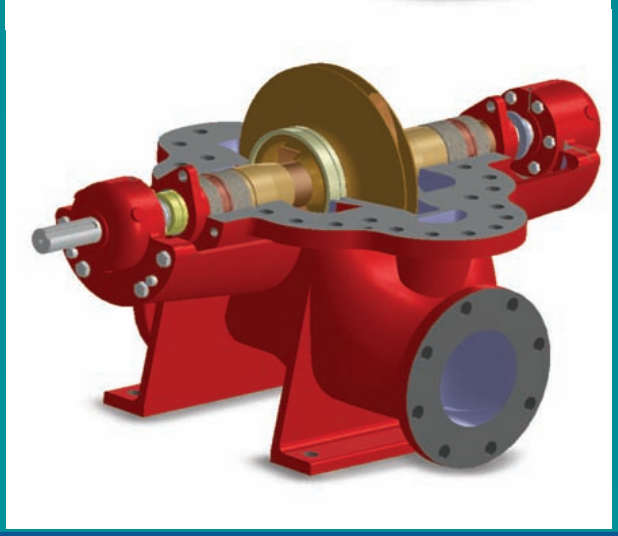

FULLER
ELECTROMECHANICAL CO.

PUMPSENSE

